FIELD MOUNTED RATE TOTALISER MODEL 202D







202D-M-V7.3 MAY 2025

IMPORTANT NOTICE

To preserve battery life, the batteries may have been disconnected and may need to be reconnected. To do this follow the steps outlined in section 9.3.

There are two battery packs (see the diagram in section 9.4) and both packs must be connected.

CONTENTS

	Safe	ty Notice	1
1.		oduction Model Number Designation Intrinsic Safety Approvals	2 3 4
2.	Spe	cification	6
3.	3.1 3.2 3.3 3.4 3.5 3.6	Tration Display Test Mode Filtering Calculation of Rate and Total Total Conversion Frequency Cutoff Linearisation	8 9 10 12 13 13
4.	_	gramming Program Steps	15 16
5.	Exar	mple	19
6.	Versions6.1 Battery Powered Version6.2 DC Power Version6.3 Relay and 4-20mA Output Version		20 21 22 24
7.	Flov	vmeter Input	26
8.	8.1 8.2 8.3	Insic Safety Connections Coils Simple Apparatus Namur Proximity Switches 4-20mA Output Alarm Outputs	31 32 32 34 36
9.	9.1 9.2 9.3 9.4	allation Wiring Maintenance General Wall Mounting Panel Mounting	38 38 39 40 41 42

CONTENTS

9.6	Main Electronics	43
9.7	Grounding	43
9.8	Dimensions	44
9.9	Terminal Designations	45
10.	Disposal	46
10.1	Instrument Disposal	46
10.2	Battery Disposal	
Index		

SAFETY NOTICES

Only competent persons with the applicable training and authorisation should work in potentially explosive atmospheres.

When this instrument is used in hazardous area, all wiring must be energy limited according to the documentation provided and the marking label attached to the instrument.

The safety of any system that incorporates Contrec 200 series instruments is the sole responsibility of the system assembler/installer.

This manual must have been fully read and understood before the installation and commissioning of any system using this instrument.

The instrument should only be operated if installed and maintained correctly

To ensure correct and safe operation of this instrument after installation and maintenance the instrument should be fully sealed via the front screws and gland entries.



SPECIAL CONDITIONS FOR SAFE USE

To comply with this products ATEX/IECEx certification the special conditions for safe use must be followed.

The Instrument type 202Di shall be mounted in an area where electrostatic charge/discharge will be avoided.

1. INTRODUCTION

The Model 202Di Rate Totaliser is a microprocessor based instrument which accepts a frequency or pulse input from a wide range of flowmeters. The instrument displays flow Rate, a Resettable Total and an Accumulated Total directly in engineering units.

The instrument is compatible with a wide range of flowmeters including turbine, paddlewheel and positive displacement flowmeters.

Three different versions of the Model 202Di are available:

- 1. A Battery Powered Version with no output.
- 2. A DC Powered Version with either:
 - i. high and low flow alarms or
 - ii. a low flow alarm and pulse output.
- 3. A Loop Powered Version with 4-20mA output and alarms as above.

The instrument is fully programmable from the front panel; the user can program scaling factors, decimal point positions, filter constants and timebase.

The Model 202Di Rate Totaliser conforms to the EMC-Directive of the Council of European Communities 2014/30/EU, the LVD directive 2014/35/EU and the following standards:

EN61326:2013


Electrical equipment for measurement, control and laboratory use – EMC requirements: Residential, Commercial & Light Industry Environment & Industrial Environment.

EN61010:2010

Safety requirements for electrical equipment for measurement, control, and laboratory use. In order to comply with these standards, the wiring instructions in Section 9.5 must be adhered to.

1.1 MODEL NUMBER DESIGNATION

The Model Number of the 202Di describes the power & output options installed and the mounting options.

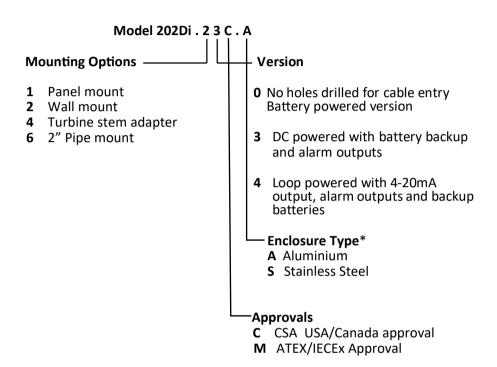

*NOTE - As standard the enclosure type is plastic, unless specified with 'A' or 'S' as above.



Model 202D (Plastic Enclosure)

4 Introduction

1.2 INTRINSIC SAFFTY APPROVALS

The Model 202Di is certified for use in hazardous areas and has IECEx, ATEX and CSA $_{\mbox{US/C}}$ approvals.

The Model 202Di certification details are:

IECEx Approval IECEx BVS 15.0099X Rating Ex ia IIB T4 Gb

ATEX Approval BVS 15 ATEX E 106 X Rating II 2G Ex ia IIB T4 Gb

Ambient Temperature: Ambient temperature of -20° to + 60°C.

When installing in hazardous areas, the instrument must be installed according to the guidelines in Section 2 and in accordance with standards for wiring and installation in hazardous areas. Failure to do so may result in the protection provided by the equipment becoming impaired.

4-20 mA/DC Power

The input can be connected to IS circuits with the following maximum values:

Ui = 28V Ii = 93mA Pi = 653mW

The internal capacitance and inductance seen on these terminals is 24nF and 0mH.

Relay Outputs

The outputs can be connected to IS circuits with the following maximum values:

```
Ui = 28V
Ii = 93mA
Pi = 490mW
```

The internal capacitance and inductance seen on these terminals is 2.4uF and 0mH.

Flowmeter Input

Entity parameters on the flowmeter enable connection to a wide range of approved sensors.

Input parameters are:

```
Ui = 24V
Ii = 20mA
Pi = 320mW
```

The internal capacitance and inductance seen on these terminals is 2.4uF and 0mH.

Output parameters are:

```
Uo = 5.36V (open circuit)
Io = 5.9mA (short circuit)
Po = 7.8mW
```

Maximum allowed external capacitance is 1000µF. Maximum allowed external inductance is 1000mH.

2. SPECIFICATION

General

Display: LCD which is continuously powered.

Resettable Total: 7 digits with 10mm (0.4") high digits. Resettable

from front panel.

Accumulated Total: Displayed when the ACCUM TOTAL button is

pressed.

Rate: 4 digits with 8.5mm (0.33") high digits.

K-factor: The pulses per unit of measure (eg. pulses/gallon)

is programmable in the range 0.000001 to

999,999.

Calibration up to ten user selected points.

Decimal Points: Decimal point positions are fully programmable for

both rate and total.

Timebase: Rate can be displayed in units per second, minute,

hour or day.

Frequency Range: 0.01Hz to 10kHz.

Signal Type: Link settable for sinewave (15mV P-P minimum),

open collector, reed switch, pulse or Namur

proximity switch.

Battery Powered Version

Type: Two lithium battery packs.

Battery Life: 5 years typical.

Loop Powered 4-20mA Output Version

Scale: The 4mA and 20mA points are programmable.

Resolution and Linearity: 0.05% of span.

Accuracy: 0.05% of span at 25°C.

0.1% (typ) of span, full temperature range.

Update Time: 0.5 second.

Connection: Two-wire.

Loop Power Supply: 9-28 Volts.

Supply Backup: Lithium battery.

DC Power/Alarm Version

Outputs: Two open collector outputs suitable for driving

DC solenoids or external relays. The outputs can be programmed to provide high and low flow alarms or pulse output and low flow alarm.

Switching Power: 200mA. 30VDC maximum.

DC Power Input: 9-28 Volt at 4mA maximum.

Supply Backup: Lithium battery.

Pulse Duration: 1ms if CALO = 2 (unscaled pulse output).

If CALO = 1 (scaled pulse output) the duration of the pulse automatically adjusts to the output

frequency:

a. 1ms if output > 50Hz.b. 10ms if output = 5...50Hz.c. 100ms if output < 5Hz.

Physical

Temperature: Operating temperature: -20°C to 60°C.

Dimensions: 98mm (3.9") high x 151mm (5.9") wide x

43mm (1.7") deep (cable glands not included).

Protection: Sealed to Type 4X or IP67 standards.

Cable Entry: By cable glands.

Wall Mounting: Universal mounting bracket supplied as standard.

Pipe Mounting: A galvanised metal bracket is available which

enables the Model 202D to be attached to

a 2" vertical or horizontal pipe.

Turbine Meter Adaptor: An optional mounting stem is available for

mounting the Model 202D directly on turbine

flowmeters which have a 1" NPT boss

Panel Mounting: Supplied with mounting brackets.

Terminals accessible from rear. The panel

mount version is not watertight.

Cutout: 141mm (5.6") wide x 87mm (3.4" high).

Max Weight: Stainless Steel - 2220g, Aluminium 900g,

Polycarbonate - 400g

Additional

Pollution Degree: 2
Over Voltage Category: II

Maximum Altitude: 2000m Above Sea Level

3. OPERATION

The Model 202D Rate Totaliser accepts a frequency or pulse input from a wide range of flowmeters. The instrument is fully programmable with all operating parameters and calculation constants programmable from the front panel. The setup parameters are stored in a non-volatile memory and are retained for at least 40 years in the event of a power loss.

3.1 DISPLAY

The Model 202D displays:

Rate

Resettable Total Accumulated Total

Both the Rate and Resettable Total are displayed continuously. The Accumulated Total is displayed only when the ACCUM TOTAL key is pressed.

The keys on the front of the 202D have the following functions:



Pressing this key will display the Accumulated Total.



This key resets the Resettable Total at any time.



This key is used during the Program Mode.

3.2 TEST MODE

Display Test

The 202D has a Test Mode which can be entered by simultaneously pressing all 3 front panel keys. The tests are as follows:

Low Test	By pressing the ACCUM TOTAL key, the low alarm output (if installed) will go low. If a 4-20mA option is installed, the output will go to 4mA.
High Test	By pressing the RESET key, and depending on the programmed pulse output mode, the high alarm output (if installed):

aic	in output (ii instaneu).
a.	will go low if CALO = 0 (high alarm output).
b.	will output 100ms pulses every 0.5 sec if CALO
	- 1 (coaled pulse output)

= 1 (scaled pulse output).c. will output 1ms pulses every 0.5 sec if CAL0 = 2 (unscaled pulse output).

If a 4-20mA option is installed, the output will go to 20mA.

By pressing the PROGRAM key, all segments of the display will flash.

To exit Test Mode, all three front panel keys are pressed simultaneously.


3.3 FILTERING


Frequency fluctuations caused by pulsating flow through a flowmeter can interfere with the precision of the rate. For this reason, the Model 202D has a digital filter which will average out these fluctuations and enable accurate readings.

The degree of filtering of the input signal can be adjusted depending on the amount of fluctuation and the particular application. Values from 1 to 99 can be programmed where 1 corresponds to no filtering and 99 corresponds to heavy filtering. Such flexibility in filtering means that highly accurate and stable readings can be obtained.

When programming the degree of filtering, it is advisable to start with no filtering (the factor equals 1) and gradually increase until a steady reading is obtained. It is important that the filtering is not too heavy because this will cause an over-damped response.

The following graph shows the time to reach 90% and 99% of a new reading for a step change in input signal.



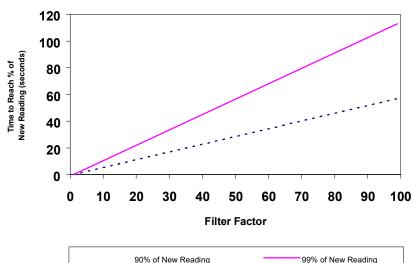

3.4 CALCULATION OF RATE AND TOTAL

The flow rate, R, is calculated as follows:

$$R = \frac{f \times H}{S}$$

where f is the input frequency in Hz (pulses/second).

H is the timebase of rate and is 1 for seconds, 60 for minutes, 3600 for hours and 86,400 for days.

S is the scaling factor (pulses/unit volume).

The scaling factor, S, is equal to the K-factor of the flowmeter expressed in pulses per unit volume. The K-factor is flowmeter dependant and is supplied with the flowmeter. It will be either on a calibration certificate or stamped on the body of the meter.

The user programs the scaling factor and selects the timebase during the programming procedure.

3.5 TOTAL CONVERSION

The Total Conversion Factor is programmed to enable the **rate** to be displayed in one engineering unit and the **totals** to be displayed in another. For example, the rate can be displayed in gallons/minute and the totals in barrels.

The Total Conversion Factor is a division factor which is used to convert the totals to a different unit. Therefore, it only affects the totals (both resettable and accumulated).

Example.

If the Rate is required in gallons/minute:

- 1. The Scaling Factor would be programmed as pulses per gallon.
- 2. The Timebase would be programmed as minutes.

If the Totals are required in barrels:

1. The Total Conversion Factor is programmed as 42 because there are 42 gallons in a barrel. All totals will now totalise in barrels.

Below is a table containing common units and their corresponding Total Conversion constants:

Rate/Unit Time	Totals	Total Conversion Factor
Gallons (US)/Unit Time	Barrels (oil)	42.000
Litres/Unit Time	Kilolitres	1000
Litres/Unit Time	m^3	1000
ml/Unit Time	Litres	1000
Mgallons/Unit Time	Acre-feet	0.32587

3.6 FREQUENCY CUTOFF

A frequency cutoff can be programmed below which flow rate is not registered. Input frequencies at or below the cutoff are totalised, however, the rate is displayed as zero.

The frequency cutoff has a default value of 0.25Hz. The cutoff should be left as 0.25Hz unless the flowmeter in use has a lower frequency.

Note that a low cutoff frequency will result in a correspondingly low response of flow rate update. For example, if the cutoff is set to 0.01Hz the 202D will continue to display the flow rate for 100 seconds even if the signal stops. This is because a cutoff frequency of 0.01Hz means that the time interval between signals is 100 seconds (period = 1/frequency). Therefore, the Model 202D must wait 100 seconds before it can determine that the flow has actually stopped.


14 Operation

3.7 NON-LINEARITY CORRECTION

Non-linearity correction enables the instrument to correct for known non-linearities in the flowmeter.

Up to 10 frequencies and scaling factors can be programmed. Frequencies must be programmed in ascending order. Data on the flowmeter non-linearity can usually be supplied by the flowmeter manufacturer in the form of a Calibration Certificate, and is the result of individual tests on a flowmeter over a range of flowrates. The Certificate will list a number of flowrates or frequencies with the measured K-factor (e.g. pulses per gallon or litre) at each flowrate.

The following diagram graphs the change in scaling factor with frequency for a hypothetical flowmeter. The heavy black line represents the actual scaling factor of the flowmeter as read from the Calibration Certificate, while the light black line is the approximation used in the instrument.

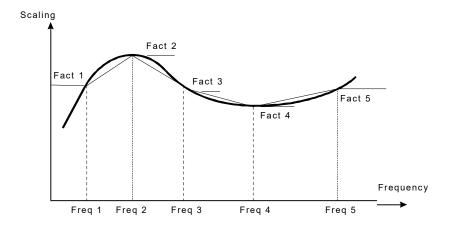

Linear Interpolation is used between points on the curve, except for Factor 1 which maintains a constant value between Frequency 1 and any Frequency below Frequency 1.

Note that the display update time will be increased to 1 second when the non linear correction option is selected with the battery powered version of the 202D.

4. PROGRAMMING

The Model 202D is fully programmable with all parameters being stored in non-volatile memory.

The Program Mode can be entered in one of two ways:

1. **Plastic Enclosure** - By removing the lower plastic cover strip (ie. the dark grey strip along the bottom of the enclosure) and replacing it the wrong side up. This brings a small magnet on the inside of the cover strip in contact with a reed switch inside the instrument.

Metallic Enclosure - By removing the metallic cover strip below the buttons. Unscrew the strip and replace the wrong side up. This brings a small magnet on the inside of the cover strip in contact with a reed switch inside the instrument.

2. By removing the front section of the enclosure which contains the main processor board and batteries.

The PROGRAM switch is used to step through the program (CAL sequences) and the Δ (ACCUM TOTAL) and > (RESET) keys on the front panel are used to change and increment the flashing digits. Note that only flashing digits can be changed.

Up to eighteen CAL steps are accessible depending on which options are installed.

The CAL number is displayed on the lower display and the parameter is displayed above it.

Parameters in Program Mode that consist of the two parts, **whole numbers** and **digits after the decimal point**, are restricted to having a maximum of 6 significant digits. Therefore the number of significant digits entered in the *whole numbers* determines the number of digits that are able to be entered in the *digits after the decimal point*.

For Example

000001 in the whole numbers makes 00000 available after the decimal place. 000100 in the whole numbers makes 000 available after the decimal place. 010000 in the whole numbers makes 0 available after the decimal place.

16 Programming

4.1 PROGRAM STEPS

Step Comment

CAL 0 Pulse Output (applies to DC Power/Alarm version only).

0 = No pulse output, low and high alarms.

1 = Scaled pulse output and low alarm.

2 = Unscaled pulse output and low alarm.

CAL 1 Scaling Factor - whole numbers.

CAL 2 Scaling Factor - digits after the decimal point.

The scaling factor is the pulses per unit of measure (e.g. pulses/litre, pulses/gallon, etc). The scaling factor can be programmed in the range of 0.000001 - 999,999.

See Section 3.4.

CAL 3 **Cutoff Frequency.**

This determines the cutoff frequency in the range of 0.01 -0.99Hz. The default setting is 0.25HZ.

Note that care must be taken when programming this value because a low value may cause a slow update time.

CAL 4 Decimal Point for Rate Display.

The flow rate can be displayed with 0, 1, 2 or 3 decimal point places.

CAL 5 Timebase for Rate.

The rate can be displayed in units per second, minute, hour or day.

0 = second

1 = minute

2 = hour

3 = day

CAL 6 Filter.

The filter constant for filtering the input signal.

No filtering.

to

99 Very heavy filtering.

Step Comment

CAL 7 Decimal Point for Total Display.

The totals can be displayed with 0, 1, 2 or 3 decimal points.

CAL 8 Total Conversion Factor - whole numbers.

CAL 9 Total Conversion Factor - digits after the decimal point.

The total conversion factor enables the rate to be displayed in one engineering unit and the totals to be displayed in another engineering unit. The total conversion factor can be programmed in the range of 0.000001 - 999,999.

Set to 1.000 if totals and rate are in the same unit, e.g. litres. See Section 3.5.

CAL 10 Low Alarm - whole numbers.

CAL 11 Low Alarm - digits after the decimal point.

CAL 10 to CAL 13 are displayed regardless of whether the

high and low alarms are installed. If the high and low alarms are not installed, these parameters can be ignored.

CAL 10 & 11 program the flow rate below which the low alarm relay will close. The value can be programmed in the range 0.000000 to 999,999.

CAL 12 High Alarm or Pulse Output Factor - whole numbers.

CAL 13 High Alarm or Pulse Output Factor - digits after the decimal point.

CAL 12 & 13 program the flow rate above which the high alarm relay will close. The value can be programmed in the range 0.000000 to 999,999.

If the scaled pulse output is selected (see CALO = 1), then the value will represent the total per pulse, e.g. 5 litres per pulse.

18 Programming

Step Comment

CAL 14 4mA Retransmission - whole numbers.

CAL 15 4mA Retransmission - digits after the decimal point.

CAL 14 to CAL 15 represent the flow rate at which 4mA will be output. If the 4-20mA retransmission is not installed, these parameters can be ignored.

CAL 16 20mA Retransmission - whole numbers.

CAL 17 **20mA** Retransmission - digits after the decimal point.

CAL 16 & 17 are the flow rates at which the output will reach 20mA.

CAL 18 Enabling and number of points for linearisation.

'00' = Linearity Disabled; '02' - '10' number of points.

If Linearity is enabled by entering a number 02 to 10, then the programming will request data as per the table below. Input points are entered in ascending order.

INP 01 Input Frequency '01' whole number

INP .00 Input Frequency '01' digits after decimal point

OUT 01 Scaling Factor **'01'** whole number

OUT .00 Scaling Factor '01' digits after decimal point

Repeat the above for the remaining scaling factors.

Any frequency greater than that of the last linearity point will be scaled at the last Scaling Factor.

SOFT Software Version.

5. EXAMPLE

A flowmeter produces 20.538 pulses per litre and has a maximum output frequency of 200Hz. It is required to display the flow rate in litres/min with 1 decimal point and the total in litres with no decimals. A 4-20mA output is installed and 4mA is to represent 0 litres/m and 20mA is to represent 500 litres/m. The instrument is then programmed as follows:

Calibration mode is entered by removing the lower cover strip (i.e. the dark grey strip along the bottom of the enclosure) and replacing it the wrong side up.

The following values are then entered:

Step		Value of Parameter	Description
Step	CAL00 CAL01 CAL02 CAL03 CAL04 CAL05 CAL06 CAL07 CAL08 CAL09 CAL10 CAL11 CAL12 CAL13 CAL14	•	No Pulse Output Scaling Factor (whole numbers) Scaling Factor (decimals) Cutoff Frequency Rate decimal position Timebase Filter disabled Total decimal position Total Conversion (set to 1.0000) Total Conversion (decimals) Low Alarm (not installed) Low Alarm (not installed) High Alarm (not installed) High Alarm (not installed) 4mA Output (whole numbers)
	CAL15	0000	4mA Output (decimals)
	CAL16 CAL17 CAL18 SOFT	00500 0000 00 1.01	20mA Output (whole numbers) 20mA Output (decimals) Linearity number of points Software Version
	JUFI	1.01	JULTIVALE VEISION

6. VERSIONS

The following table summarises the features of each of the different versions of the Model 202D:

Model Number	202DI.X0	202DI.X3	202DI.X4
Version	Battery Powered	DC Powered	Loop Powered
Power	Lithium	DC Powered; 9-28V at 4mA Maximum	Loop Powered; 9-28 Volts with 4- 20mA Output
Output	None	Alarms - two open collector outputs Or Pulse Output and Low Flow Alarm	
Supply Backup	N/A	Lithium	Lithium

Where X denotes the mounting options and will be replaced by one of the following numbers:

- **0** No holes drilled for cable entry
- 1 Panel mount
- 2 Wall mount (standard)
- 4 Turbine adaptor
- **6** 2" pipe mount (galvanised)

6.1 BATTERY POWERED VERSION

The battery powered version of the Model 202Di is designed for operation in the field without external power sources. Lithium batteries provide sufficient power to operate the instruments for up to 5 years and the operator is warned of a low power condition by a message on the LCD display.

New batteries can be purchased via Contrec or our distributors and replaced in the field without compromising the IS approvals. There are two battery packs in each instrument and care must be taken to replace only one pack at a time so that there is always power connected to the memory. Failure to do this may result in loss of totals.

Please note that only Contrec supplied replacement batteries can be used

Please contact your local Contrec distributor for more information

6.2 DC POWER VERSION

The DC power version will operate from an external power source between 9-28VDC and draws no more than 4mA. This enables the instrument to be powered from AC mains adaptors and eliminates the need to run mains voltages in the field.

The instrument uses lithium batteries for backup if the DC power is interrupted.

However, alarms and/or pulse outputs are not supported if the DC power is interrupted.

Open collector outputs are also provided for high and low flow rate alarms. If a pulse output is programmed, terminals 6 and 5 will act as a pulse out. The output can sink up to 200mA and can be used to power external relays, lights or audible alarms. The outputs are internally protected against voltage spikes caused by relays and coils.

Both outputs are separately isolated via opto-isolators.

The switching points can be programmed during the setup mode and the low flow alarm will switch on whenever the flow rate drops below the programmed flow rate. Similarly, the high alarm switches on whenever the flow exceeds the high setpoint.

If a scaled pulse output is programmed, a pulse will be output every preset value of the total. For example, if the total is in litres, then programming 5 will output one pulse every 5 litres. If an unscaled pulse output is programmed, output pulses will follow input frequency from a flowmeter.

Specification for Alarm Outputs

Maximum Current (sink): 200mA. Maximum Voltage: 30Vdc.

Saturation Voltage: 0.8Vdc across outputs when in the "on" state.

Isolation: Both outputs are separately isolated.


Pulse Frequency: 500Hz maximum.

Pulse Duration: 1ms if CALO = 2 (unscaled pulse output).

If CALO = 1 (scaled pulse output) the duration of the pulse automatically adjusts to the output

frequency:

a. 1ms if output > 50Hz.b. 10ms if output = 5...50Hz.c. 100ms if output < 5Hz.

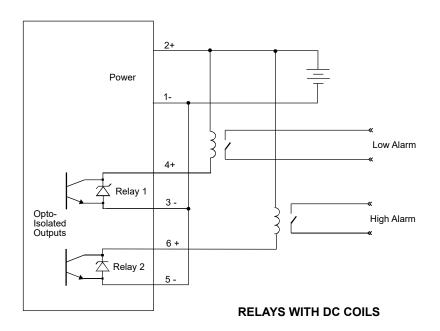

6.3 RELAY AND 4-20mA OUTPUT VERSION

This version combines features of the DC powered with a 4-20mA output.

The 4-20mA output provides a two-wire retransmission of the flow rate. Both the 4mA and 20mA points are fully programmable so that the output can span across the entire operating range or, alternatively, across a small section of the operating range.

The instrument draws its operating power from the 4-20mA loop and uses lithium batteries for backup if the 4-20mA loop is interrupted. The alarm/pulse outputs are not supported if the 4-20mA loop is interrupted.

Specification

Resolution and Linearity: 0.05% of span.


Accuracy: 0.05% of span at 25°C.

0.1% (typ) of span, full temperature range.


Response (4-20mA): 0.5 second. Loop Power Supply: 9-28 Volts.

Since the 4-20mA output is designed to provide power to the Model 202D, it is not isolated from the input. Hence, all sensors *must* be self-powering (such as reed switches and coils). If external power is required to power the sensor (e.g. Namur switches, Hall effect sensors or opto-sensors), the power supply delivering the external power must be isolated from the 4-20mA loop supply.

Typical Connection

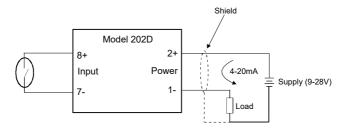

Connection to a Sensor requiring External Power

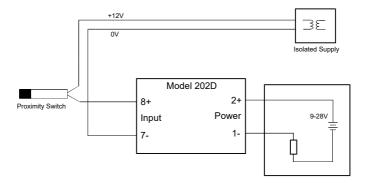

7. FLOWMETER INPUT

The Model 202D has an input conditioning circuit which will accept signals from most **pulse** or **frequency** producing flowmeters. Links on the rear panel enable the input circuit to be configured for different signal types.

The input will interface directly to:

Turbine flowmeters.
Open collector outputs.
Reed switches.
Logic signals.


Two-wire proximity switches.

The following pages give examples of interconnection to various signal outputs. A circuit diagram of the input is also provided.

For pulse or logic type signals, the input switching threshold is 1.3 volts. That is, the input signal must have a "low" voltage of less than 1.2 volts and a "high" voltage of greater than 1.4 volts.


For flowmeters with coils, the minimum input voltage is 15mV P-P.

All inputs are protected for over voltage up to 28 volts.

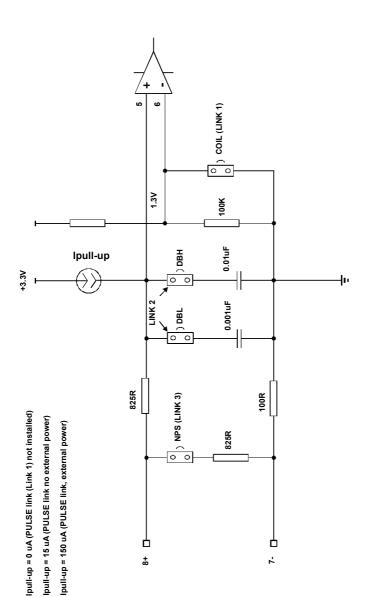


SIMPLIFIED FREQUENCY INPUT CIRCUIT

1. Squarewave, CMOS or Pulse




Link Settings




Switching threshold voltage is 1.3 volts.

2. Open Collector


With 15µA/150µA internal pull up current




Link Settings



3. Reed Switch - Battery Powered With 15µA internal pull up current




Link Settings




eg. Positive displacement flowmeters with reed switch outputs.

Note: For a switch or reed input with contact bounce link DBL can be switched "on". This will eliminate the effect of switch bounce while limiting the input frequency to 200Hz.


Reed Switch - External DC Power With 150µA internal pull up current






Note: For a switch or reed input with contact bounce link DBH can be switched "on". This will eliminate the effect of switch bounce while limiting the input frequency to 200Hz.

5. Coils



Note: If the input has a very high impedance, the following link settings should be used:


Link Settings



825R input impedance


eg. Millivolt signal from paddlewheel or turbine (15mV P-P minimum).


Link Settings



30 Flowmeter Input

6. Namur Proximity Switch







For IS connections of Namur switches see Section 8.

Note: Use this connection for a DC powered version of the Model 202D.

7. Namur Proximity Switch - External DC Power





For IS connections of Namur switches see Section 8.

Note: Use this connection for battery or loop powered versions of the Model 202D.

If a 4-20mA output is installed, the supply to the proximity switch must be isolated.

8. INTRINSIC SAFETY CONNECTIONS

When installing the Model 202Di in hazardous areas, the wiring and installation must comply with appropriate installation standards.

The approval uses entity parameters on the input for connections to the flowmeter and associated apparatus type approval for the 4-20mA output. The 4-20mA output must, therefore, only be connected to barriers with the specified safety parameters as shown on the following page.

8.1 COILS

The Model 202Di will connect directly to a turbine flowmeter or paddlewheel with a certified Intrinsically Safe (IS) coil or other certified IS sensor which produce a pulse input provided they do not exceed the following input parameters:

Ui = 24V Ii = 20mA Pi = 320mW

The maximum allowed capacitance and inductance of the pulse or coil including the cabling is:

Cext = 1000μ F Lext = 100mH

The internal capacitance and inductance of the Model 202Di seen on the input are negligibly small with Ci = 0.02uF and Li = 0mH. The maximum voltage and current produced by the Model 202Di on its inputs (terminals 8 & 7) are:

Uo = 5.36V (open circuit) Io = 5.9mA (short circuit) Po = 7.9mW

32 Intrinsic Safety Connections


8.2 SIMPLE APPARATUS

Devices such as reed switches which can be classed as "simple apparatus", as defined in the CENELEC standards EN60079, can be connected to the Model 202D without certification.

8.3 NAMUR PROXIMITY SWITCHES

Connection to certified Namur proximity switches is permitted as shown on the following page with the following maximum input parameters:

Ui = 24V Ii = 20mA Pi = 320mW

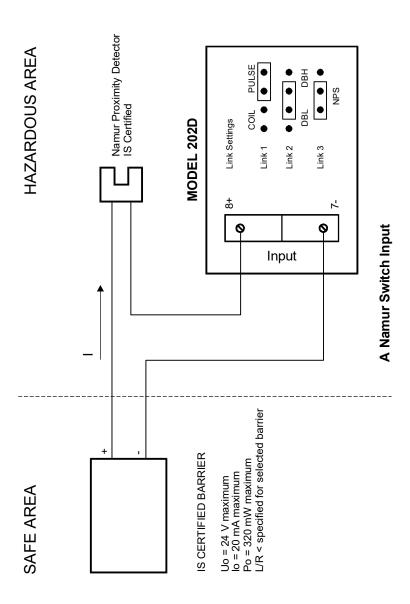


34 Intrinsic Safety Connections

8.4 4-20mA OUTPUT

The 4-20mA analog output can be connected to suitably certified devices providing the circuit is protected with a barrier with the maximum safety parameters:

Uo = 28V Io = 93mA Pmax = 0.653W

The input capacitance on these terminals is 2.4nF max and the inductance is negligible.

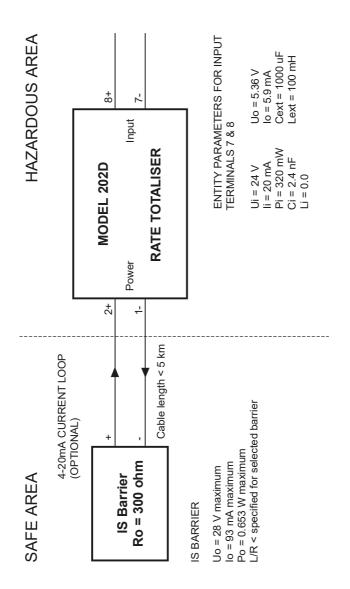

Input Parameters and 4-20mA Retransmission


8.5 ALARM OUTPUTS

The low alarm and high alarm/pulse output can be connected to suitably certified devices providing the circuit is protected with a barrier with the maximum safety parameters:

Uo = 28V Io = 93mA Pmax = 0.490W

The input capacitance on these terminals is 2.4nF max and the inductance is negligible.

Note that the two alarm outputs must be kept as independent IS circuits and each protected with their own barrier. It is not permissible to connect these circuits via a common barrier.

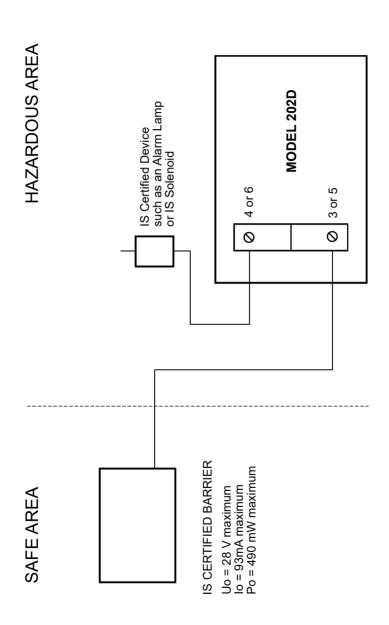

9.INSTALLATION

9.1 WIRING

All wiring must be undergone by a competent persons with the necessary training and comply to all national and local standards and legislation

Use wire with a minimum temperature rating of ≥ 65 Degrees Celsius

When connecting the 202D it is good practice to use shielded cable. The shield should be connected to earth at one end of the cable. The other end of the shield should not be connected.

This wiring practice is mandatory in order to comply with the requirements for Electromagnetic Compatibility as per EMC-Directive 2004/108/EC of the Council of the European Community.

9.2 MAINTENANCE

All printed circuit boards must be repaired by Contrec. In the case of a fault, no attempt should be made to repair the instrument as the intrinsically safe certification may be impaired.

For further details contact Contrec Ltd or Contrec representatives listed at the end of this manual.

All batteries for use in hazardous areas must be supplied by Contrec. No substitute batteries are permitted as the battery packs contain certified energy limiting devices and insulation protection.

The inside of the instrument should remain clean and free of contaminants. After routine maintenance the instrument must be re sealed to ensure no ingress occures

9.2.1 Cleaning

Clean with mild detergent or maximum 35% isopropyl solution

9.3 GENERAL


Ensure that all gland entries not used are blanked with IP rated gland plugs/blanking caps.

The instrument should be installed so that it is protected from impact and extreme weather conditions

Install in a way the minimises vibration


9.4 WALL MOUNTING

A wall mounting bracket is supplied with each instrument. Round head screws should be used to attach the bracket to the wall (countersunk screws should not be used). The bracket is mounted first with the tray section at the bottom. The instrument is then mounted on the bracket with two screws as shown below.

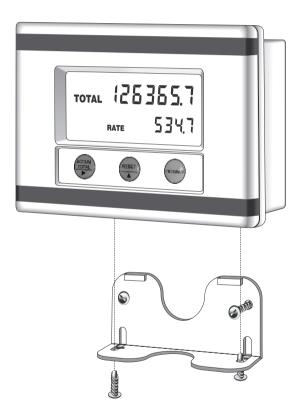

9.5 PANEL MOUNTING

The panel mount version of the Model 202D is supplied with two panel mount brackets and plug-in terminals which are accessible from the rear of the instrument.

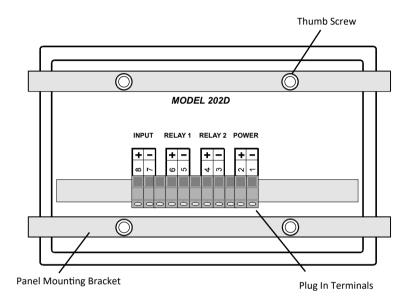

Rear View of 202D Panel Mount Case

The cutout for the panel mount version is 141mm (5.55") wide x 87mm (3.43") high.

NOTE - The metallic enclosure can not be supplied as a panel mounting instrument

9.5.1 REMOVING THE FRONT PANEL - PLASTIC ENCLOSURE

Only open the instrument in a clean, dry environment

The front panel should be removed as follows:

- 1. Remove the top and bottom cover strips (ie. the dark plastic strip) by levering a screwdriver under one end.
- 2. Undo the screws retaining the front. Do not remove the screws, they are retained by O-rings.
- 3. Remove the front panel from the housing.

To replace the front cover, follow the above procedure in reverse. Ensure that the front panel is aligned at connector points before tightening the screws.



9.5.2 REMOVING THE FRONT PANEL - METALLIC ENCLOSURE

The front panel should be removed as follows:

- Unscrew the 4 x pozi drive head screws from each corner of the front panel.
- 2. These are retaining screws, held onto the front panel with o-rings
- 3. Once fully loosened the front panel will pull away from the housing.

To replace the front cover, follow the above procedure in reverse. Ensure that the front panel is aligned at connector points before tightening the screws.




If slightly stiff, the enclosure has a small gap on the right side of the front panel. This can be used to open the instrument with a tool.



9.6 THE MAIN ELECTRONICS

The front section of the housing contains the microprocessor and display. It is possible to adjust the display contrast via a small potentiometer on the board. The Display Contrast is shown below and this can be adjusted for optimum contrast.


Adjacent to this control is a RESET switch which can be used to reset the microprocessor. *Note that pressing this button will set all totals to zero*.

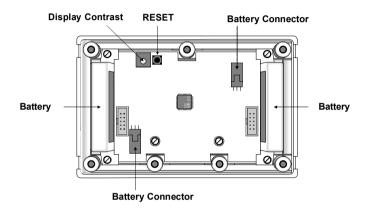

9.7 GROUNDING

NOTE. This only applies to the metallic enclosure


On one side of the enclosure a ground point is available to attach the 202D to the nearest protective earth (PE).

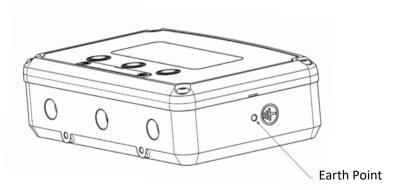


44 Installation

9.8 INSTRUMENT DIMENSIONS

9.8.1 Aluminium / Stainless Enclosure

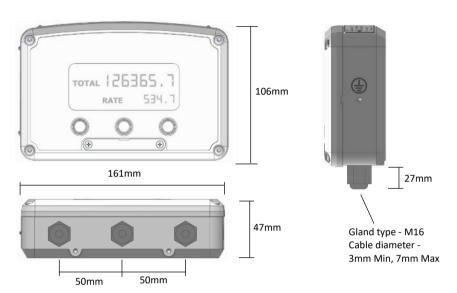

9.8.2 Plastic Enclosure

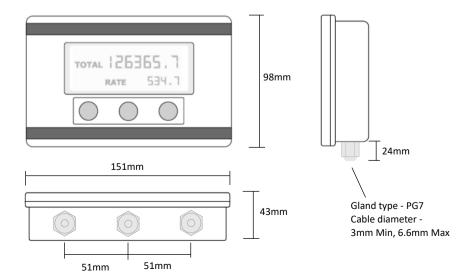

9.9 TERMINAL DESIGNATIONS

All versions

Pulse (-) / Coil Input
 Pulse (+) / Coil Input
 High Alarm (-) or Pulse Output (-) if installed
 High Alarm (+) or Pulse Output (+) if installed
 Low Alarm (-) if installed
 Low Alarm (+) if installed

4-20mA Output

2 4-20mA (+) 1 4-20mA (-)

DC Power Versions

2 DC Power +9 to 28V

1 DC Power 0V

10. DISPOSAL

10.1. Instrument Disposal

Contrec instrumentation should not be thrown into the general waste system.



If within EU member states, this instrument should be disposed of according to the guidelines set by the WEEE (Waste Electrical and Electronic Equipment) directive 2012/19/EU. If outside of the EU, this equipment should be responsibly disposed of according to local and national regulations for EEE (Electrical and Electronic Equipment).

By not discarding of this product along with other house hold waste you are preserving natural resources and reducing waste sent to landfill and incinerators.

Remove batteries and dispose of separately (see *Disposal of Batteries*) before disposal of Contrec instrumentation.

10.2. Disposal of Batteries

Batteries have an environmental impact, safe and responsible disposal should be undertaken.

In all EU member states, as per Directive 2006/66/EC, batteries must not be thrown away with general waste. Contact your local environmental authority for information regarding disposal or recycling of used batteries, alternatively they can be returned directly to Contrec Ltd. for disposal.

Please Contact Contrec Ltd before returning batteries for disposal.

Index

4-20mA Output, 24

Α

Accumulated Total, 8 Alarm Outputs, 36

В

Battery Powered, 21

C

CAL Sequences, 15 Cutoff Frequency, 16

D

DC Power, 22 Decimal Point, 16, 17 Display, 6, 8 Display Test, 9 Disposal, 46 Dimensions, 44

F

Filtering, 10 Flow Rate, 12 Frequency Cutoff, 14

G

Grounding, 42

Н

High Alarm, 18

ı

Index, 47 Input Signal, 26 Installation, 38 Intrinsic Safety, 4, 31

L

Linearity 14 Link Settings, 28 Low Alarm, 17 Low Test, 9

M

Model Number, 3

0

Operating Temperature, 7 Operation, 8

Ρ

Panel Mount, 39 Programming, 15 Protection, 7 Pulse Output, 16

R

Rate, 8 Removing the Front Panel, 40, 41 Resettable Total, 8

S

Scaling Factor, 12, 16 Specification, 6

Т

Temperature, 9 Terminal Designations, 45 Test Mode, 9 Timebase, 16 Total Conversion, 13

WWall Mounting,, 38